



Land Capability Services

Site & Soil Assessment  
for  
On-site Effluent Disposal

Lot 63 DP1188859  
18 Marquess Place  
Murrumbateman NSW 2582

October 2022

## CONTENTS

Introduction	3
Site Characteristics	4
Site Evaluator	5
Site Assessment	6
Soil Assessment	7
System Selection	8
Management Prescriptions	9
Water Balance	11
Nutrient Balance	12
Appendix 1: Soil Survey Sheet	13
Appendix 2: NSW Accredited AWTS	14
Appendix 3: Important Reading	15

## INTRODUCTION

**Scope** This report provides site and soil assessment for on-site effluent disposal at the applicant's proposed new 4-bedroom dwelling and 2-bedroom secondary dwelling. An Aerated Wastewater Treatment System (AWTS) is proposed.

An AWTS coupled with surface or subsurface irrigation provides a suitable form of effluent treatment for the site and soil characteristics of the land in question.

The management recommendations include the size and location of the proposed irrigation area.



## References

- AS/NZS 1547:2012 *On-site domestic wastewater management*  
*On-site sewerage management for single households* (Anon, 1998)  
Hird, C. (1991). *Soil Landscapes of the Goulburn 1:250 000 Sheet*

## SITE CHARACTERISTICS

The terrain of the site comprises a gently inclined upper slope of 3-4 degrees overlying Hawkins volcanics. The slope across the proposed irrigation area has a linear planar to slightly linear convergent configuration ensuring that runoff does not concentrate within the site. The soil at the site is an imperfectly drained Chromosol within the Boorowa soil landscape. It comprises sandy clay loam topsoil horizons to 8cm and 32cm respectively, overlying a sandy clay, medium clay then heavy clay subsoil horizons to 43cm, 80cm and 100cm+ respectively.



## SITE EVALUATOR

**Company Name** Land Capability Services  
**ph:** 0417 694 638  
**email:** [rgmiller@me.com](mailto:rgmiller@me.com)  
**Date of assessment** October 19, 2022

**Signature of evaluator**



## SITE INFORMATION

**Address** Lot 63 DP1188859, 18 Marquess Place,  
Murrumbateman, NSW 2582

**Council area** Yass Valley

**Owner/developer** Dallwitz

**Area:** 1.03 ha

**Site plan attached** Yes

**Photograph attached** Yes

**Intended water supply** Rainwater

**Expected wastewater quantity (litres/day)** 960  
(4 bedroom + 2 bedroom dwelling potentially housing 8 occupants generating design flows of 120L/person/day = 960 litres/day)

**Local experience** Aerated wastewater treatment systems provide adequate treatment of effluent on appropriate soils.



## SITE ASSESSMENT

**Climate** Warm to hot summers with a high evaporative deficit. Cool to cold winters with a small evaporative deficit

**Where appropriate:**

**Rainfall water balance calculated** Yes  
**Land application area calculated** Yes  
**Wet weather storage area calculation attached** NA

**Flood potential:**

**Land application area above 1 in 20 year flood level** Yes  
**Land application area above 1 in 100 year flood level** Yes  
**Electrical components above 1 in 100 year flood level** Yes

**Exposure** Well exposed with minimal shade

**Slope** Linear planar to slightly linear convergent

**Landform** Upper slope

**Run-on** Slight in upslope location

**Seepage** None

**Erosion Potential** Slight with adequate vegetation

**Site Drainage** Imperfectly drained

**Fill** None in application area

**Groundwater:**

**Horizontal distance to groundwater well used for domestic water supply** 250m

**Groundwater vulnerability map referred to** Yass LEP 2013 Sheet CL2\_005

**Vulnerability rating** Not within vulnerability area

**Bores in the area and their purpose** Stock & domestic

**Buffer distance from wastewater management system to:**

**Perennial watercourses** NA

**Dams** >40m

**Drainage lines** >40m

**Boundary of property** >3/6m

**Driveway** >6m

**Swimming pools** >6m

**Dwelling** >15m

**Is there sufficient land area for:**

**Application system (including buffer distances)** Yes

**Reserve application system (including buffer distances)** Yes

**Surface rocks** None within effluent application area

## SOIL ASSESSMENT

<b>Depth to bedrock or hardpan</b>	>100cm
<b>Depth to soil water table</b>	>100cm
<b>Hydraulic loading rate</b>	
<b>Soil structure</b>	Moderate to weakly structured topsoil Moderately structured subsoil
<b>Soil texture</b>	Sandy clay loam topsoil Sandy to medium clay subsoil
<b>Permeability category</b>	(4) 0.12-0.5m/day in topsoil (6) <0.06m/day in subsoil
<b>Hydraulic loading recommended for irrigation system</b>	1.6mm/day irrigation
<b>Coarse Fragments</b>	5% to 5mm in topsoil 5% to 5mm in B <sub>1</sub> subsoil
<b>Bulk Density</b>	Estimate 1.5 in topsoil Estimate 1.3 in subsoil
<b>Ph (1:5 Water)</b>	Topsoil 6.4 Subsoil 7.0
<b>Electrical conductivity (dS/m)</b>	Topsoil .06 Subsoil .03
<b>Geology &amp; soil landscape survey</b>	
<b>Presence of discontinuities</b>	None
<b>Presence of fractured rock</b>	None
<b>Soil landscape reference</b>	Boorowa
<b>Dispersiveness</b>	Present in remoulded A <sub>2</sub> topsoil EAT 3 Present in remoulded subsoil EAT 3

## SYSTEM SELECTION

### Consideration of connection to a centralised sewerage system

Nearest feasible connection point	2.2km
Potential for future connection to centralised sewerage	Unlikely
Potential for future connection to reticulated water	Unknown

### Type of land application system best suited to site:

Surface or shallow subsurface irrigation

**Reason** Medium clay subsoil precludes subsoil dispersal of effluent

### Type of treatment system best suited to site and application system:

Aerated wastewater treatment system

**Reason** Superior standard of treatment for site and soil conditions.

## GENERAL COMMENTS

### Are there any specific environmental constraints?

None provided outcropping rock to the south of the effluent application area is avoided

**Are there any specific health constraints?** None



## MANAGEMENT PRESCRIPTIONS

Aerated wastewater treatment systems treat effluent to an improved, or secondary standard, reducing any impact on groundwater and making available water for landscaping and other purposes. The following prescriptions are site specific and must be strictly adhered to, in order to maximise water and nutrient uptake, and thus minimise runoff and seepage.

The AWTS must be accredited by NSW Health. Most residential systems as listed in Appendix 2 can treat a wastewater load from 10 persons, However the client should confirm with the manufacturer or agent that a particular system can effectively treat a daily wastewater load of 9600 litres/day, the theoretical wastewater load calculated from 8 persons occupying the proposed two houses on the property. In some cases it may be preferable to install one of the smaller commercial grade systems as offered by some of these manufacturers.

An irrigation area of 600 m<sup>2</sup> should be determined within the area shown as suitable in Figure 1.

The irrigation area should be sown to improved perennial pastures, which once established, should be regularly mown to improve rates of nitrogen uptake.

The treated effluent may be applied by surface irrigation. Surface sprays must be of the large droplet type that do not produce aerosols and are to be regularly rotated throughout the effluent application area to evenly spread hydraulic and nutrient loads.

The treated effluent may also be applied by sub-surface irrigation. Auto flush return to the tank should be installed to ensure flocculants in the lines are recycled back to the tank. Pressure compensating dripper heads to be used. Vacuum breakers or air release valves to be installed at highest point in irrigation field, to prevent migration of soil into irrigation lines. Irrigation laterals to be installed on the contour at 100mm depth and at nominal 1000mm spacing. A single disc filter of nominal 100mm diameter (85mm internal) to be installed upstream of irrigation system. Filter to be cleaned at quarterly service intervals.


The distribution line from the AWTS to the effluent irrigation area must be buried at least 300mm underground or 450mm where vehicles pass over.


The irrigation area must not be disturbed by any building activity such as stockpiles of excavated material or vehicle traffic.

Detergents should be selected for low levels of phosphorus and sodium.  
(See appendix 3)

Fig 1. Areas suitable for effluent application



Photo point 

Slope direction 

## WATER BALANCE

A water balance model is helpful in assessing the sensitivity of the design to various input and output characteristics.

Irrigation area sizing using Nominated Area Water Balance for Zero Storage																
Site Address:		18 Marquess Place, Murrumbateman														
Date:		Assessor:														
<b>INPUT DATA</b>																
Design Wastewater Flow	Q	960	L/day	Based on maximum potential occupancy and derived from Table 4 in the EPA Code of Practice (2013)												
Design Irrigation Rate	DIR	3.5	mm/day	Based on soil texture class/permeability and derived from Table 9 in the EPA Code of Practice (2013)												
Nominated Land Application Area	L	600	m <sup>2</sup>													
Crop Factor	C	0.5-0.8	unitless	Estimates evapotranspiration as a fraction of pan evaporation; varies with season and crop type <sup>2</sup>												
Rainfall Runoff Factor	RF	1.0	unitless	Proportion of rainfall that remains onsite and infiltrates, allowing for any runoff												
Mean Monthly Rainfall Data	Yass(Linton Hostel) (070014)			BoM Station and number												
Mean Monthly Pan Evaporation Data	Canberra Airport (070091)			BoM Station and number												
Parameter	Symbol	Formula	Units	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Days in month	D		days	31	29	31	30	31	30	31	31	30	31	30	31	365
Rainfall	R		mm/month	50.3	45.5	46.7	49	49.9	57.9	59.6	59.3	56.8	64.5	56.6	55.8	651.9
Evaporation	E		mm/month	260.4	207.2	176.7	111	66.2	48	52.7	80.6	114	161.2	198	248	1726
Crop Factor	C		unitless	0.60	0.60	0.70	0.70	0.60	0.60	0.60	0.70	0.60	0.80	0.80	0.80	
<b>OUTPUTS</b>																
Evapotranspiration	ET	ExC	mm/month	208	166	124	78	41	29	32	48	80	129	158	198	1290.73
Percolation	B	DIRxD	mm/month	108.5	96	106.5	106.0	108.5	106.0	108.5	108.5	105.0	108.5	106.0	106.5	1277.5
Outputs		ET+B	mm/month	316.8	263.76	232.2	182.7	149.4	133.8	140.1	156.9	184.8	237.5	263.4	306.9	2568.2
<b>INPUTS</b>																
Retained Rainfall	RR	RxRF	mm/month	50.3	45.5	46.7	49	49.9	57.9	59.6	59.3	56.8	64.5	56.6	55.8	651.9
Applied Effluent	W	(QxD)/L	mm/month	59.5	53.8	59.5	57.6	59.5	57.6	59.5	59.5	57.6	59.5	57.6	59.5	700.8
Inputs		RR+W	mm/month	109.8	99.3	106.2	106.6	109.4	115.5	119.1	118.8	114.4	124.0	114.2	115.3	1352.7
<b>STORAGE CALCULATION</b>																
Storage remaining from previous month			mm/month	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Storage for the month	S	(RR+W)-(ET+B)	mm/month	-207.0	-164.5	-126.0	-76.1	-40.0	-16.3	-21.0	-36.0	-70.4	-113.4	-149.2	-191.6	
Cumulative Storage	M		mm	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Maximum Storage for Nominated Area	N		mm	0.00												
	V	NxL	L	8												
<b>LAND AREA REQUIRED FOR ZERO STORAGE</b>																
			m <sup>2</sup>	112	123	160	215	299	379	370	305	225	172	139	119	
<b>MINIMUM AREA REQUIRED FOR ZERO STORAGE:</b>																
			m <sup>2</sup>	380.0												

Based on a potential quantity of 960 litres/day of wastewater, spread across 600 m<sup>2</sup> of irrigation area, the effluent application rate of 1.6mm/day results in a moisture deficit in all months of the year. Importantly, the deficit is theoretical and it should be noted that saturation is possible at any time following periods of extended wet weather.

The application rate of 1.6mm/day is comparatively conservative, against the rate of 3.5mm/day for a sandy clay loam determined from table M1 from AS1547:2012.

## NUTRIENT BALANCE

The nutrient balance examines the discharge of nitrogen and phosphorus against the capacity of plants and soil to assimilate those nutrients. Excess nutrients may eventually impact upon watercourses via surface run-off or groundwater.

<b>Nitrogen Balance</b>							
<b>Site Address:</b>		<b>18 Marquess Place, Murrumbateman</b>					
<b>SUMMARY - LAND APPLICATION AREA REQUIRED BASED NITROGEN BALANCE</b>							<b>350</b> m <sup>2</sup>
<b>INPUT DATA<sup>1</sup></b>							
<b>Wastewater Loading</b>				<b>Nutrient Crop Uptake</b>			
Hydraulic Load	960	L/day	Crop N Uptake	200	kg/ha/yr	which equals	54.78 mg/m <sup>2</sup> /day
Effluent N Concentration	25	mg/L					
% N Lost to Soil Processes (Geary & Gardner 1996)	0.2	Decimal					
Total N Loss to Soil	4800	mg/day					
Remaining N Load after soil loss	19200	mg/day					
<b>NITROGEN BALANCE BASED ON ANNUAL CROP UPTAKE RATES</b>							
<b>Minimum Area required with zero buffer</b>			<b>Determination of Buffer Zone Size for a Nominated Land Application Area (LAA)</b>				
Nitrogen	350	m <sup>2</sup>	Nominated LAA Size	500	m <sup>2</sup>		
			Predicted N Export from LAA	-2.98	kg/year		
			Minimum Buffer Required for excess nutrient	0	m <sup>2</sup>		

960 litres/day wastewater quantity at 25mg/l total N concentration  
 = 8.76 kg Nitrogen discharged per year, applied over an irrigation area of 600 m<sup>2</sup> = 146 kg/ha/yr.

A mix of existing native and improved grasses should provide a rate of nitrogen uptake of around 200kg/ha/yr at this location.

Total nitrogen loss to soil processes should account for 29kg/ha/yr.

Therefore the discharge of nitrogen should be balanced by plant uptake and soil processes.

## Phosphorus Loading

960 litres/day wastewater quantity at 10 mg/l of P  
 = 3.5kg P discharged per year, applied over an irrigation area of 600m<sup>2</sup>  
 = 58kg/ha/yr.

Native & improved grasses should provide a rate of P uptake of around 20kg/ha/yr.

Balance of 38kg/ha/yr. applied to P sorption capacity of soil;

P sorption capacity of in-situ soil 5300kg/ha. <sup>1</sup>

Lifetime of irrigation area 139 years in terms of P sorption capacity.

<sup>1</sup> SCA "Design and Installation of On-site Wastewater Systems", P. Sorption Uptake Values (Typical)

APPENDIX 1: SOIL SURVEY SHEET

Soil Survey Sheet

Date: 19.10.22

Site Address: 18 Marquess Place Milton Keynes

Client: Hewlett



Land Capability Services

Depth	Boundary	Texture	Structure	Colour	Mottles	Coarse Frag	Consistence	Plasticity
A <sub>1</sub>	0-80	Light Sandy Clay loam	Massive	Dry yellow brown	-	5 to 5mm	Moist weak	Slight
A <sub>1</sub>	80-320	Coarse Sandy Clay loam	Weak	Moist yellow brown	-	5 to 5mm	Moist weak	Slight
B <sub>1</sub>	320-430	Sandy Clay	Massive	Dry Orange yellow	-	5 to 5mm	Moist weak	Very
B <sub>1</sub>	430-800	Medium Clay	Massive	Dry Orange yellow	-	-	Moist Firm	Very
B <sub>1</sub>	800-1000+	Heavy Clay	Weak	Moist Orange yellow	-	-	Moist Firm	Very

## APPENDIX 2: NSW HEALTH ACCREDITED AWTS

<b>AWTS Model</b>	<b>Company/Agent</b>	<b>Contact</b>
Ultra Clear, ST8, ST10	Capital Waterworks	02 6258 1378
Taylex ABS 1500	Clearwater Sewage	0419 229 313
Fuji Clean CE1200, CRX1500,	Fuji Clean Australia Pty Ltd	1300 733 619
Alpha Treat DP10	Alpha Treat Pty Ltd	0409 042 689
BioSeptic Performa	Bioseptic	1300 658 111
Aqua Advanced	Everhard Industries Pty Ltd	
Garden Master Elite Advanced	Garden Master	02 4932 1011
Ozzi Kleen RP10	Suncoast Waste Water	1800 450 767
Super-Treat SE 10, SB 10	Super-Treat Systems	02 4422 3861
Taylex Poly ABS, ABS, DMS	Clearwater Sewage	0419 229 313
Turbojet Single Advanced	Icon-Septech	1300 557 143
Alpha Treat DP10	EcoWater Qld Pty Ltd	07 3205 3666
Earthsafe SS10	Earthsafe Australia Pty Ltd	1800 043 635
ECO PRO	Eco-Septic t/a Econocycle	02 4774 1316
UBI Aqua	Global Tanks	07 4697 7099
Kingspan BioFicient	Kingspan Water & Energy	1300 736 562
Rivatec RWT10	Rivatec Environmental	1300 327 847

## Appendix 3: Important Reading

Phone Office/Lab (02) 6775 1157  
Fax (02) 6775 1043  
ABN: 72 212 385 096  
email: rob@lanfaxlabs.com.au  
Website: <http://www.lanfaxlabs.com.au>  
493 Old Inverell Road  
(P.O. Box W90) Armidale NSW 2350  
Director: Dr Robert Patterson FIEAust, CPSS, CPAg  
Soil Scientists and Environmental Engineers

# Lanfax Laboratories

Performance certified by Aust. Soil & Plant Analysis Council

### LAUNDRY PRODUCTS RESEARCH

Laundry products were purchased by *Lanfax Labs* from supermarkets in Armidale, NSW and a number of boutique products were provided by manufacturers. A total of 41 liquids and 54 powders were tested by mixing each product at the manufacturer's recommended dose for either front loading or top loading automatic washing machines. The dose was calculated at the full cycle load, that is 75 L for front loaders and 150 L for top loaders. The full cycle accounts for the water used in the wash, spin, rinse, deep rinse and spin rinse cycle. The quantities of 75 L for front loaders and 150 L for top loaders were taken from averaged rates for those machines (Patterson, 2004).

Each sample was mixed with cold (20°C) deionised water (to replicate good quality rainwater). Where town water supplies are used, the values reported for sodium concentrations may increase because of sodium in the reticulated water – that will vary from location to location, usually higher in inland than coastal towns. Each sample was shaken for 30 minutes to replicate the washing action.

The concentrations of sodium and phosphorus (and other elements) were measured on the samples using Inductively Coupled Plasma (ICP) technology in accordance with current Good Laboratory Practices at *Lanfax Labs*.

Only sodium (g/wash) and phosphorus (mg/L) are reported in the graphs presented here.

Additional information on this unique research may be obtained at: [www.lanfaxlabs.com.au/laundry.htm](http://www.lanfaxlabs.com.au/laundry.htm)

Other papers on laundry detergents can be found at: [www.lanfaxlabs.com.au/publications.html](http://www.lanfaxlabs.com.au/publications.html)

#### HOW TO READ THE GRAPHS

Each product is represented by two bars: the top bar (if present) shows the phosphorus concentration (mg/L); while the lower bar shows the sodium load (g/wash). The graph is arranged in ranked order of sodium load. Figure F1 is for 54 detergents at the front loader rate, Figure T1 is for 89 detergents at the top loader rate.

#### Sodium Load

For all on-site systems that apply the effluent by surface or subsurface application, the levels of sodium in the discharge are critical to long term absorption. Choose the product with the lowest sodium load (g/wash). Levels above 20 g/wash are likely to be detrimental to plants and the soil although plant tolerance and soil types will vary. The shorter the bar, the lower the load. When in doubt, choose the lower sodium load.

The detergents with long sodium bars (greater than 20 g/wash) should not be thrown onto your favourite garden as the sodium may be detrimental to the plants. High pH (see the website for pH data) is also detrimental to plants and soil. The pH of liquids (average pH 8) is generally lower than pH of powder detergents (average pH 10.5).

#### Phosphorus Concentration

The choice of a suitable level of phosphorus in the greywater (laundry water discharge) will depend upon the soil type and the use of the effluent. In some soils, phosphorus is not a real concern because of the natural ability of the soil to immobilize the phosphorus and limit its leaching from the disposal site. In other soils, phosphorus is likely to build up to high levels and leach from the soil. It is preferable to choose the lower phosphorus values as well as the low sodium values. The load of phosphorus for each product is available in the website data.

#### ©Copyright Restriction

This material may only be reproduced in full (three pages) for educational purposes. None of the graphs should be construed as an endorsement of one product over another, or that one product is superior or inferior to another. The data are presented as measurements of fact, ranked in order of sodium.

*This research was funded by Lanfax Labs and was independent of any manufacturer or other organisation.*

*Caution: Formulations may have changes since these products were purchased in 2005.*

---

Soil survey and analytical assessments, landscape analysis and plant nutrient relationships  
Independent research and commercial analytical laboratories. Environmental management consultants

**Figure F1 - FRONT LOADING MACHINE CYCLE**  
**Full wash cycle: Front loader = 75 L**


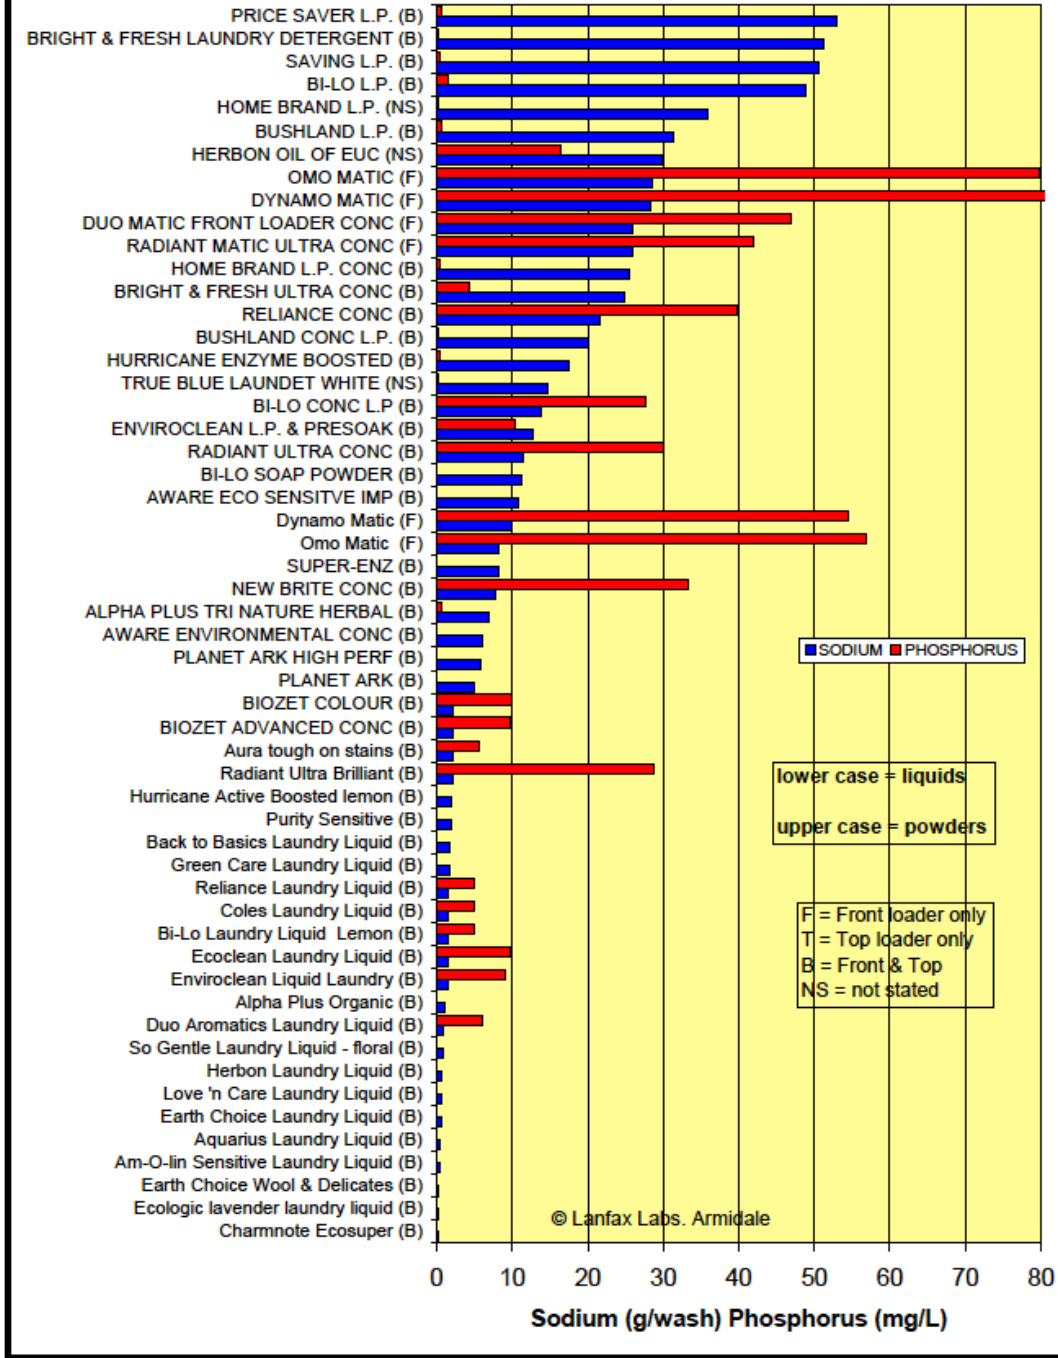




Figure T1 - TOP LOADING MACHINE CYCLE

Full wash cycle: Top loader = 150 L

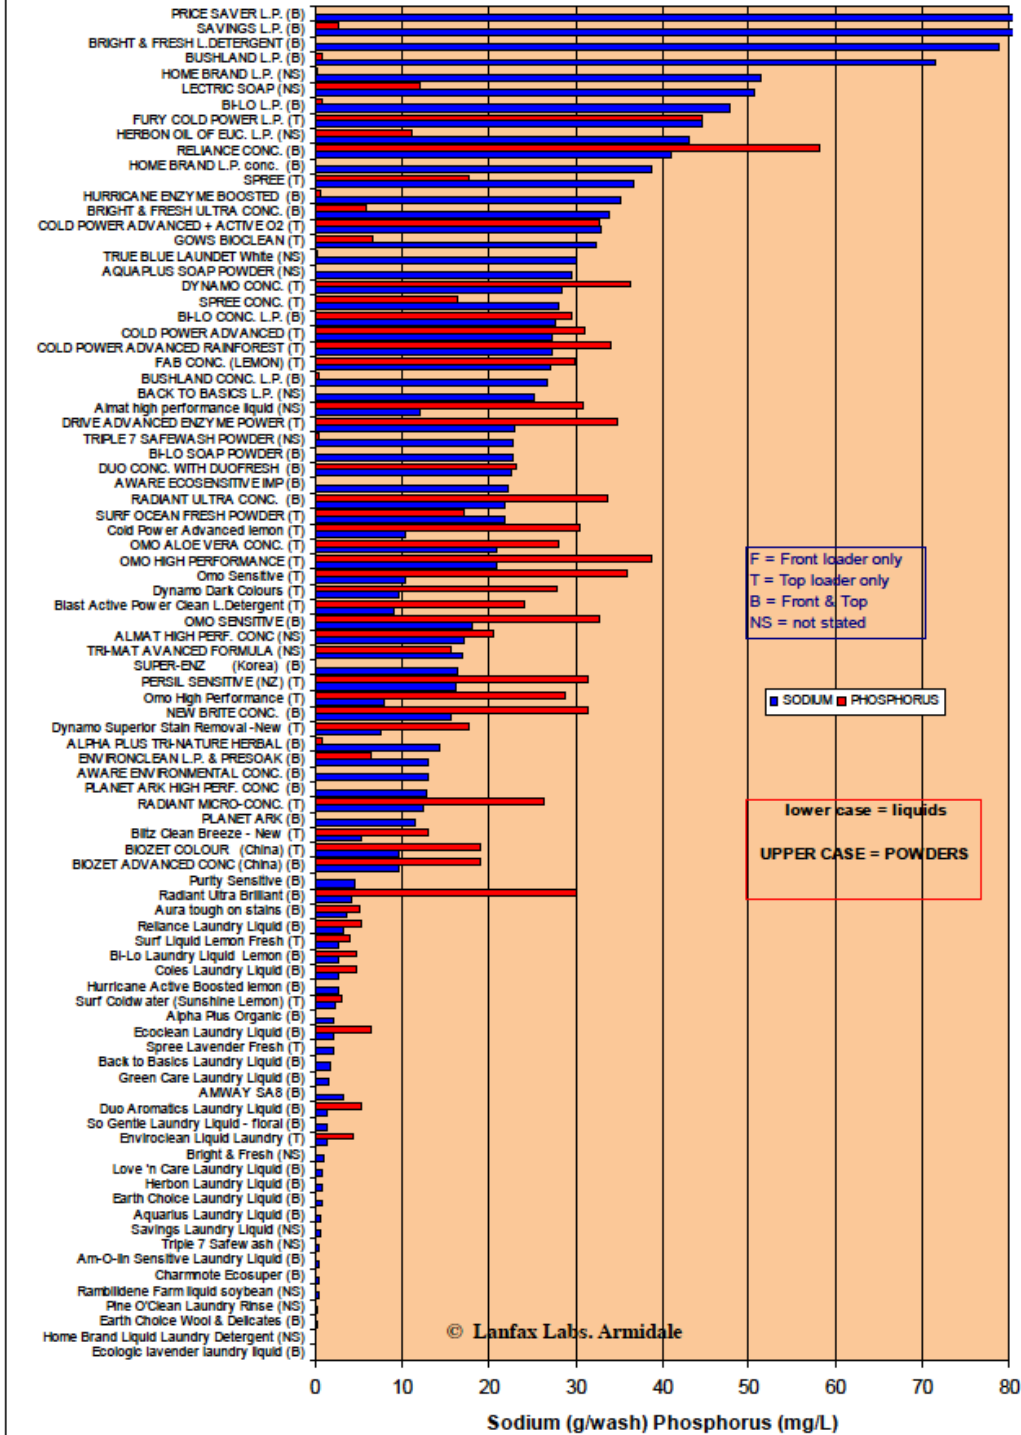

## NOTES